


- 1) SETTER TO BE FORD TVBHH72-9W-1133 OR APPROVED EQUAL.
- 2) PRESSURE REDUCING VALVE TO BE WILKINS BR4EC OR APPROVED EQUAL.
- 3) S BAR TO BE ST-2-31084-01 WITH PRV OR APPROVED EQUAL.
- 4) METER BOX MUST BE CARSON 2200-18 WITH TOUCH READ HOLE LID OR APPROVED EQUIVALENT.
- 5) THIS CONFIGURATION IS REQUIRED WHEN THE WATER PRESSURE AT THE WATER MAIN EXCEEDS 120 PSI.
- 6) PRESSURE REDUCING VALVE SHALL BE INSTALLED ON PUBLIC WATER SYSTEM SIDE OF SETTER BEFORE WATER METER.

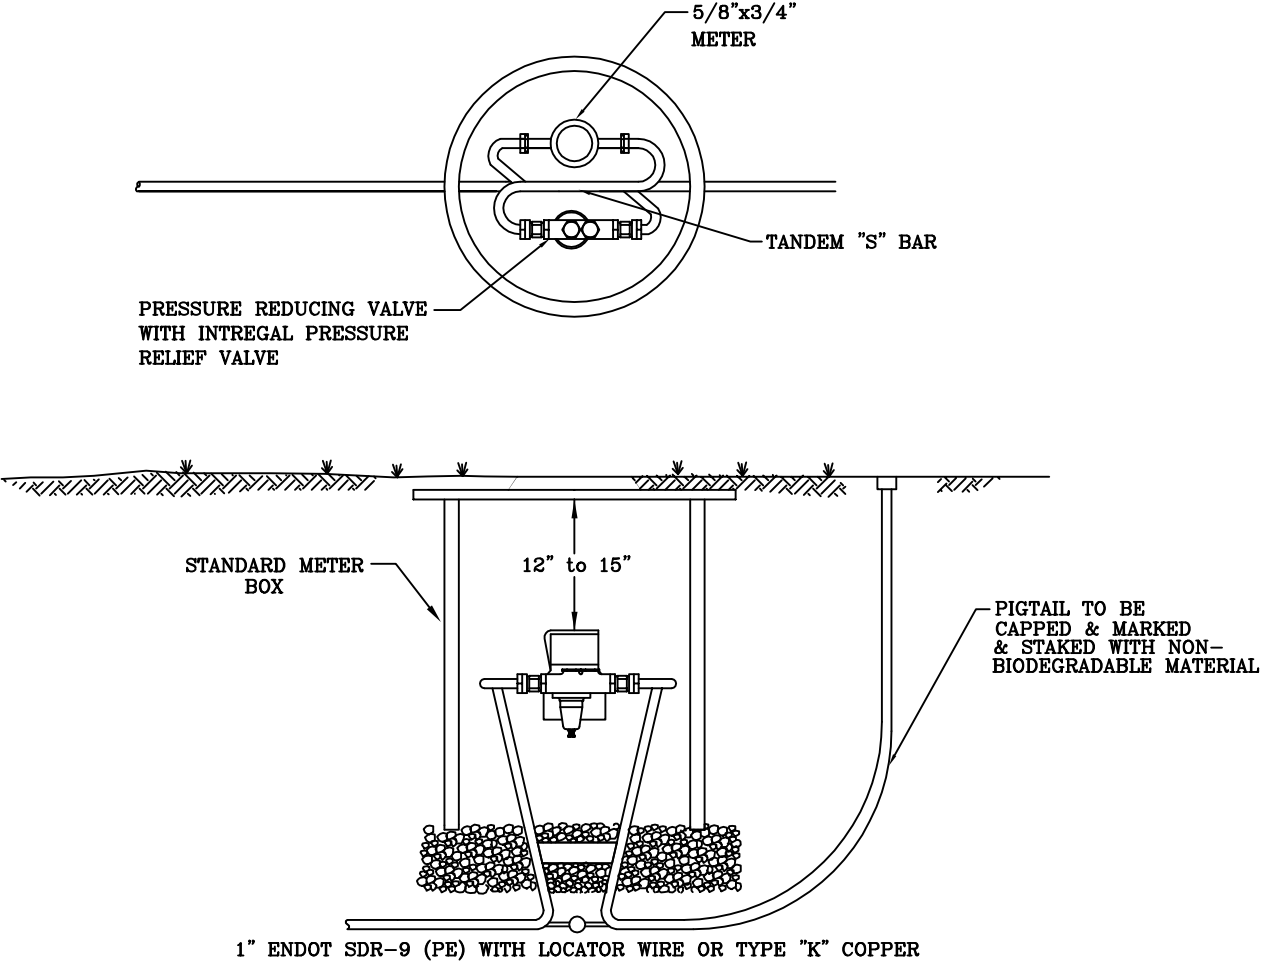

REVISIONS				SINGLE RESIDENTIAL SERVICE FOR HIGH PRESSURE (LINE PRESSURE OVER 120 PSI)	DRAWING W-02
NO.	DATE				
ORIGINAL	12/01/06				